

Evaluation Report "Great American Shake" Metal Roof Assembly

Manufacturer:

Green American Home

(A division of Isaiah Industries)

8510 Industry Park Drive

Piqua, OH 45356

(800) 543-8938

for

Florida Product Approval

FL 20735.1 R1

Florida Building Code 7th Edition (2020)

Method: 1 - D

Category: Roofing

Sub - Category: Metal Roofing

Product: "Great American Shake"

Material: Aluminum

Support: Wood Deck

Prepared by:

James L. Buckner, P.E., SECB

Florida Professional Engineer # 31242

Florida Evaluation ANE ID: 1916


Project Manager: Diana Galloway

Report No. 20-240-GAS-A19W-ER

(Revises 16-132-GAS-A19W-ER, FL20735.1 R1)

Date: 10 / 01 / 20

This item has been electronically signed and sealed by James L. Buckner, P.E., on this date using a Digital Signature. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

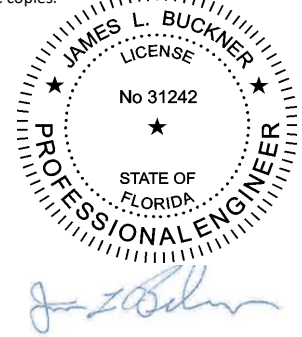

Contents:

Evaluation Report

Pages 1 – 8

2020.10.02 18:48:16 -04'00'

Manufacturer:	Green American Home (A division of Isaiah Industries) 8510 Industry Park Drive Piqua, OH 45356 (888) 705-5656 https://www.greenamericanhome.com/
Product Name:	Great American Shake
Product Category:	Roofing
Product Sub-Category	Metal Roofing
Compliance Method:	State Product Approval Rule 61G20-3.005 (1) (d)
Product/System Description:	"Great American Shake" Aluminum roof panel, with a wood shake or slate appearance, attached to Wood Deck with nails, concealed clips and a four-way interlocking design.
Product Assembly as Evaluated:	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none">1. Roof Panel2. Panel Clips3. Fasteners4. Underlayment
Support:	Type: Wood Deck (Design of support and its attachment to support framing is outside the scope of this evaluation.) Description: <ul style="list-style-type: none">• 15/32" or greater plywood,• or Wood plank (min. specific gravity of 0.42)
Slope:	Minimum slope shall be in compliance with FBC Chapter 15 based on the type of roof covering, applicable code sections and in accordance with manufacturer's recommendations.
Performance:	Wind Uplift Resistance: <ul style="list-style-type: none">• Design Uplift Pressure: (Refer to "Table A" attachment details herein)

- 56 PSF

Performance Standards:	<p>The product described herein has demonstrated compliance with:</p> <ul style="list-style-type: none">• UL 580-06 – <i>Test for Uplift Resistance of Roof Assemblies</i>• UL 1897-12 – <i>Uplift test for roof covering systems</i>
Standards Equivalency:	<p>The UL 580-94 & UL 1897-98 standard version used to test the evaluated product assembly is equivalent with the prescribed standards in UL 580-06 & UL 1897-12 adopted by the Florida Building Code 7th Edition (2020).</p>
Code Compliance:	<p>The product(s) described herein have demonstrated compliance with the performance standards listed above as referenced in the Florida Building Code 7th Edition (2020).</p>
Evaluation Report Scope:	<p>This building envelope product is evaluated for compliance with the structural wind load requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 61G20-3.001.</p>
Limitations and Conditions of Use:	<ul style="list-style-type: none">• <u>Scope of “Limitations and Conditions of Use” for this evaluation:</u> This evaluation report for “Optional Statewide Approval” contains technical documentation, specifications and installation method(s) which include “Limitations and Conditions of Use” throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under “Optional Statewide Approval”.• <u>Option for application outside “Limitations and Conditions of Use”</u> Rule 61G20-3.005(1)(e) allows engineering analysis for “project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code”. Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.• This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBUCK Engineering is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design.• All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC, including but limited to Sections 1504.3.2, 1506.5, 1506.6 and 1507.4.4.• Design of support system is outside the scope of this report.• Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.• This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)
Quality Assurance:	<p>The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through Farabaugh Testing & Engineering (FBC Organization ID# QUA 7733).</p>

**Components &
Materials:
(by Manufacturer)**

Roof Panel:

Material: Aluminum
Thickness: 0.019" (min.)
Panel Width: 12" nominal (max.) Coverage
Panel Length: 24" nominal
Alloy Type: 3105-H26
Corrosion Resistance: Per FBC Section 1507.4.3

Great American Shake

Roof Panel Clips:

Material: Aluminum
Thickness: 0.031"
Alloy Type: 3003 H14
Dimensions: 1.75" (tall) x 2.25" (long) x 1.24" (base)
Corrosion Resistance: Per FBC Section 1506.7

Fastener:

Type: Annular Ring Shank Roofing Nails
Size : 3/16" dia. (7/16" head dia.) x 1-3/4" long
Corrosion Resistance: Per FBC Section 1506.5
Standard: Per ASTM F 1667

Underlayment:

Material and application shall be in compliance with FBC Section 1507.1.1 and in accordance with applicable code sections and manufacturer's recommendations.

Installation:

Installation Method:

(Refer to "TABLE A" below and drawings at the end of this evaluation report.)

1. **Eight** clips per shingle (See drawings at end of this report)
2. Clip spacing: Per Table A Below
(along the length of the panel, along the top)
3. **One** nail per clip
(through the guide hole of the clip)
4. Tuck bottom lock of succeeding layer of shingles into top lock of preceding layer of shingles to form an integral interlock.
5. Attach succeeding shingles in a staggered pattern per the following:
Full Panel, 10-3/8", 14-1/4", 6", Repeat
6. Minimum fastener penetration thru bottom of support, 3/16".
7. For panel construction at the end of panels, refer to manufacturer's instructions and any site specific design.

TABLE "A" "Great American Shake" (0.019" Alum.) attached to Wood Deck ALLOWABLE LOADS	
Design Pressure (ASD):	- 56 PSF
Clip Spacing:	4"
# Fasteners per Clip:	1
# Clips per Shingle:	8
Notes: <ul style="list-style-type: none">• Allowable design pressure(s) for allowable stress design (ASD).	



Install the "Great American Shake" roof panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 7th Edition (2020). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

Referenced Data:


1. UL 580 & UL 1897 Uplift Test
By Farabaugh Testing & Engineering (FBC Organization #TST ID: 1654)
Report #: T173-07, Report Date: 04/18/07
2. Equivalency of Test Standard Certification
By James L. Buckner, P.E. @ CBUCK Engineering
(FBC Organization # ANE 1916)
3. Quality Assurance
By Farabaugh Testing & Engineering (FBC Organization ID# QUA 7733)
4. Certification of Independence
By James L. Buckner, P.E. @ CBUCK Engineering
(FBC Organization # ANE 1916)

**Installation Method
Green American Home
"Great American Shake" (0.019" Aluminum) Roof Panel attached to Wood Deck**


Drawings

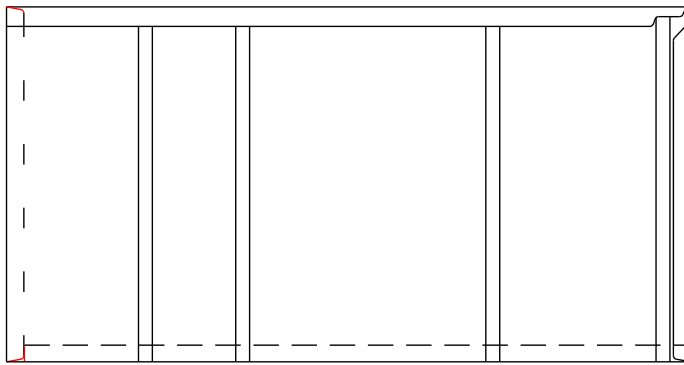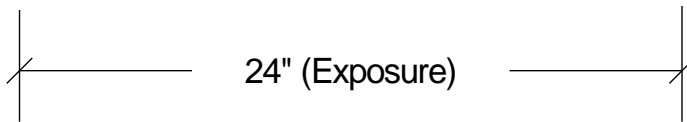

Typical Panel Profile

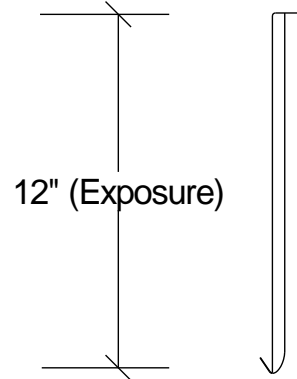


Panel Side View

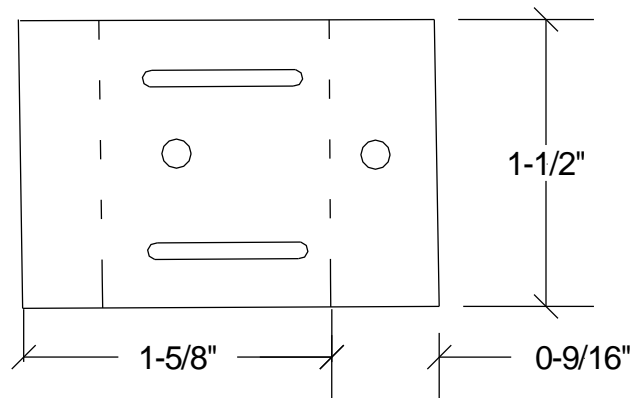


Typical Panel Clip Profile

Installation Method
Green American Home
Great American Shake" (0.019" Aluminum) Roof Panel attached to Wood Deck

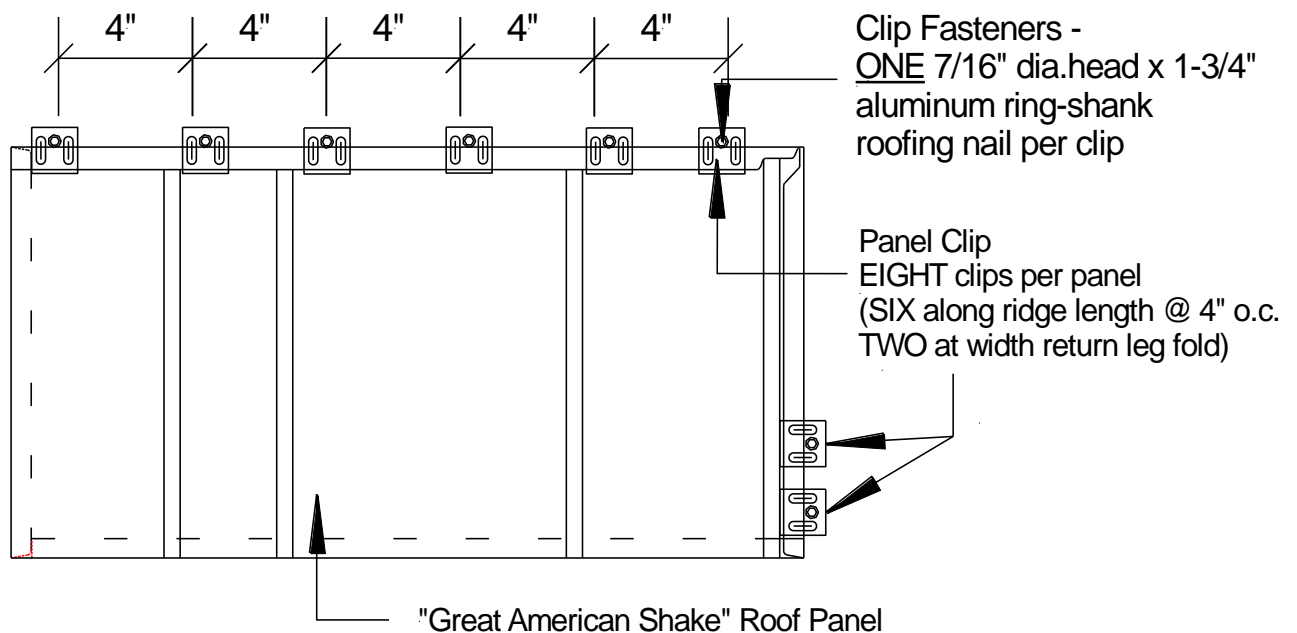

Typical Clip Assembly
Section Plan View

Installation Method Green American Home "Great American Shake" (0.019" Aluminum) Roof Panel attached to Wood Deck

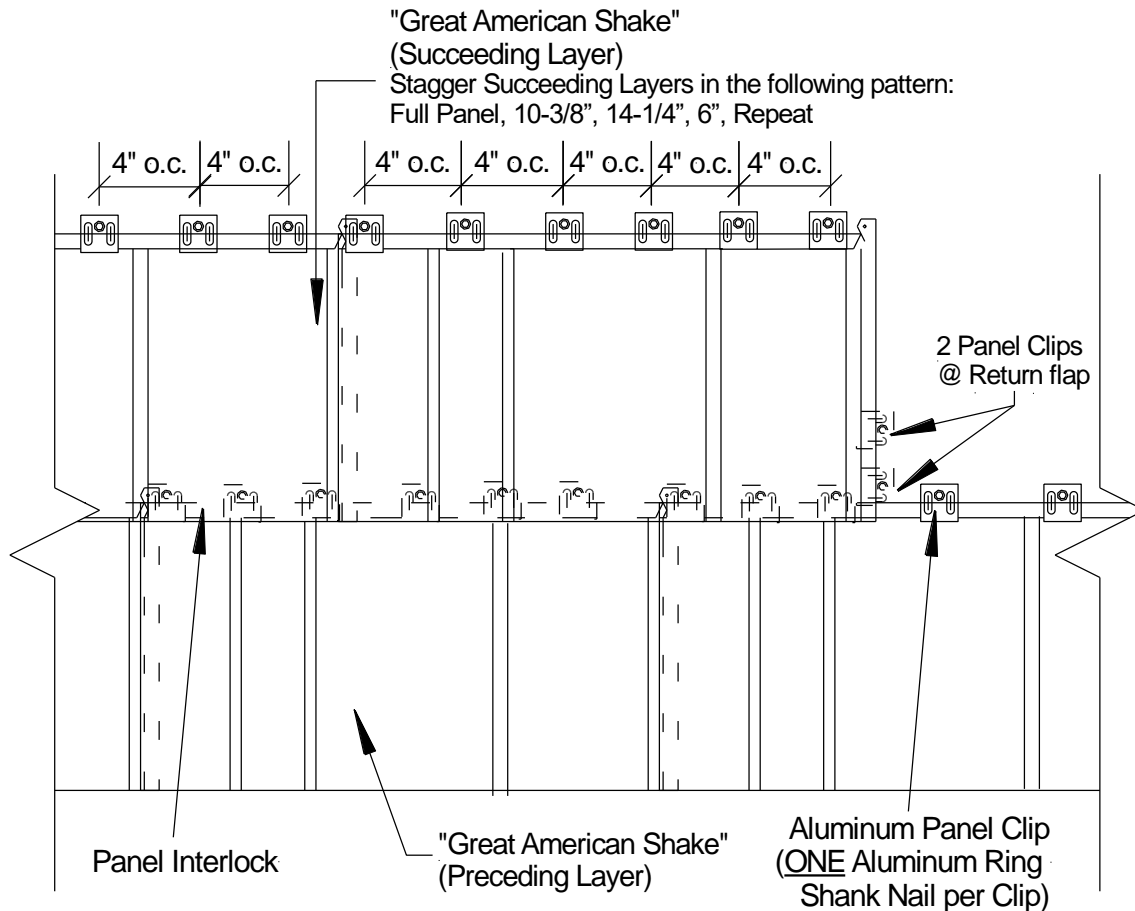

Typical Roof Assembly Plan View

TABLE "A"	
"Great American Shake" (0.019" Alum.) attached to Wood Deck	
ALLOWABLE LOADS	
Design Pressure (ASD):	- 56 PSF
Clip Spacing:	4"
# Fasteners per Clip:	1
# Clips per Shingle:	8
Notes:	
• Allowable design pressure(s) for allowable stress design (ASD).	